


**NOTE A**

CONCRETE TO BE CAST A MINIMUM OF 7 DAYS BEFORE INSTALLATION OF EQUIPMENT. (GRADE C25 DPC - 20mm GRAVEL)

 PUSH BUTTON  
 CONTROL


 CUSTOMER'S MAINS ISOLATER OR DISTRIBUTION BOARD  
 1 Ph / 230V / 6A supply

CONCRETE FOUNDATION BLOCK  
 250 x 250 x 250 DEEP (IF REQUIRED)

CONCRETE FOUNDATION BLOCK  
 600 x 600 x 500 DEEP  
 SEE NOTE 'A'

TIP SUPPORT  
 (WHEN REQUIRED)

4 CORE (15 SQ mm Min Multicore XLPE / SWA / PVC)  
 3 CORE (15 SQ mm Min Multicore XLPE / SWA / PVC)  
 ø 100 DUCT

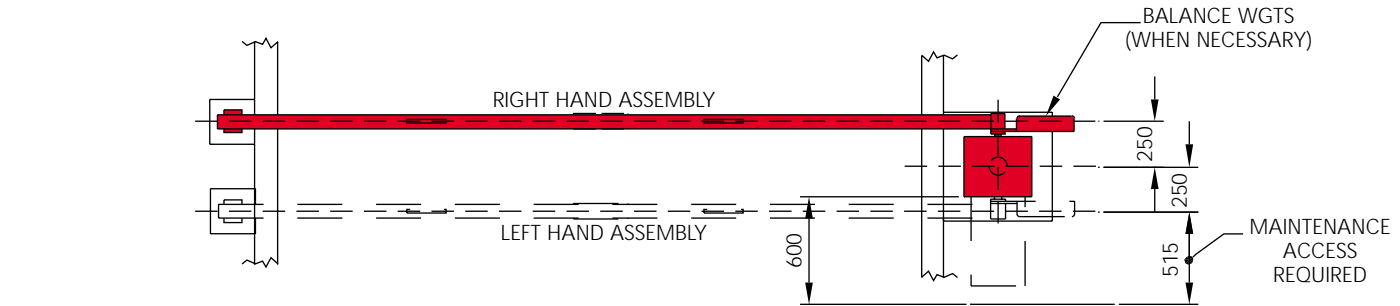

**ELECTRICAL SPECIFICATION.**

Voltage (V) : 230  
 Frequency (Hz) : 50  
 Load Current (A) : 6  
 Rating (kW) : 0.37

**OPTIONAL ACCESSORIES SHOWN**

- PVC Curtain
- Stop Signs
- Boom Lights
- Tip Support Post